


REBAR TO BE MIN.
 HORIZONTAL: 10M REBAR @ 12" FROM TOP OF WALL
 & 10M REBAR @ 24" o/c MAX. LOCATED IN THE
 INSIDE 1/2 OF WALL SECTION & w/ MIN 1 1/4"
 COVER.
 VERTICAL: 10M REBAR @ 10" o/c.

REBAR AS PER O.B.C. ONT. REG. 332/12.
 REBAR MAY VARY AS PER MANUFACTURER'S
 DETAILS & SPECS. MANUFACTURER TO PROVIDE
 SHOP DWGS FOR REVIEW BY BUILDER & COPY FOR
 BUILDING INSPECTOR PRIOR TO CONSTRUCTION.

FOUNDATION PLAN
 SCALE: 1/4" = 1'-0"

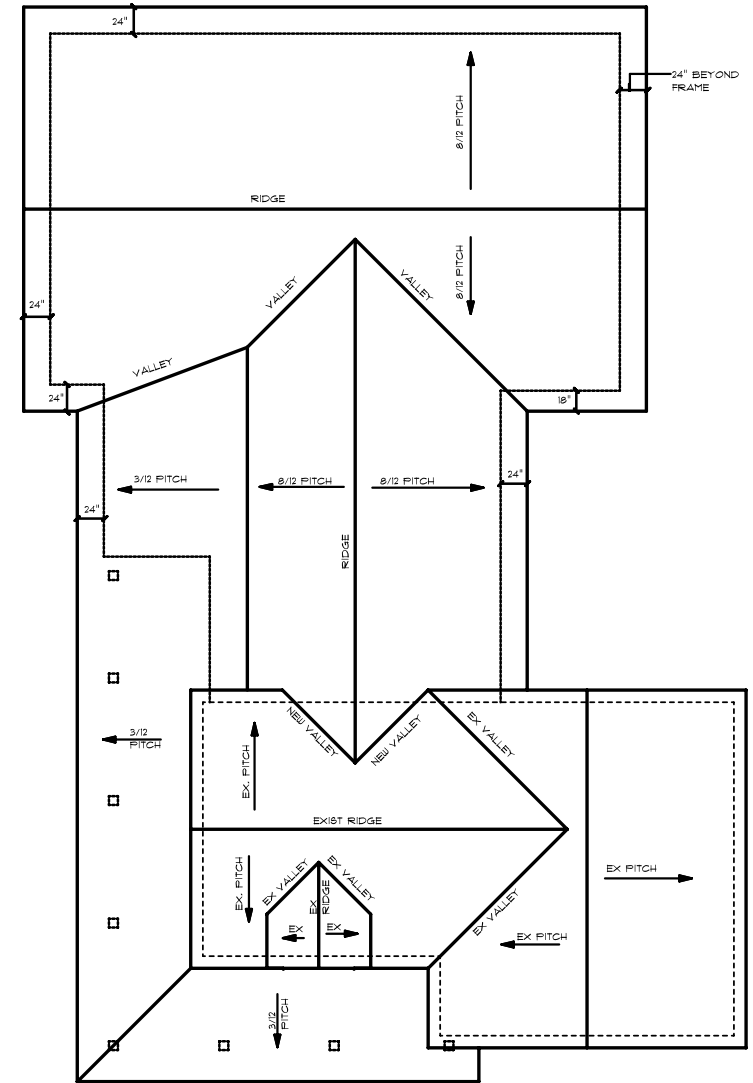

ROOF PLAN
 SCALE: 3/16" = 1'-0"

ROOF VENT REQUIREMENTS
 - PROVIDE UNOBSTRUCTED VENT AREA OF NOT LESS THAN
 1/300 OF THE INSULATED CEILING AREA.
 - VENTS TO BE ROOF TYPE, EAVE TYPE, GABLE END TYPE,
 OR ANY COMBINATION THEREOF, & SHALL BE DISTRIBUTED
 UNIFORMLY ON OPPOSITE SIDE OF THE BUILDING WITH NOT
 LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT
 TOP & BOTTOM OF SPACE.

SAMPLE

**RESIDENTIAL
 HOME DESIGNS**

Mark Barnetson
 Residential Design Consultant 705-328-1838

ONTARIO
 REGISTERED
 DESIGNER
 MARK BARNETSON
 ECI 21887

GARLAND	
253 THUNDERBRIDGE RD., LINDSAY	
SCALE: AS NOTED	DRAWN BY: MB
DATE ISSUED: DEC 2013 - FOR CONSTRUCTION	
ADDITION & RENOVATION	
JOB #: 13-D-182	DWG #: A2